



Su socio estratégico en soluciones de control

SENSORES

Duct Temperature Sensors

T - 42



Email

ivupro@anzures.com.ar



Web

anzures.com.ar



Redes sociales



Teléfono

+54 11 6012 5590

Overview

The Duct Temperature Sensor is a passive resistive sensor. It comes in a variety of probe lengths and optional mounting enclosures shown below. The sensors come with standard accuracy.

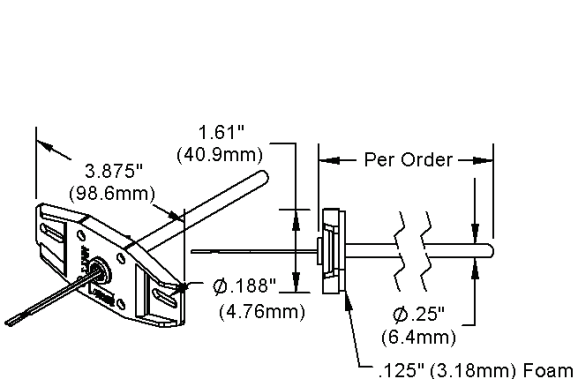


Figure 1: Duct Unit with no box

Part #s:

- NSB-10K-2-D-4-NB-5 (4" probe, 5' leads)
- NSB-10K-2-D-4-NB-10 (4" probe, 10' leads)
- NSB-10K-2-D-4-NB-15 (4" probe, 15' leads)
- NSB-10K-2-D-8-NB-10 (8" probe, 10' leads)
- NSB-10K-2-D-12-NB-10 (12" probe, 10' leads)
- NSB-10K-2-D-18-NB-10 (18" probe, 10' leads)

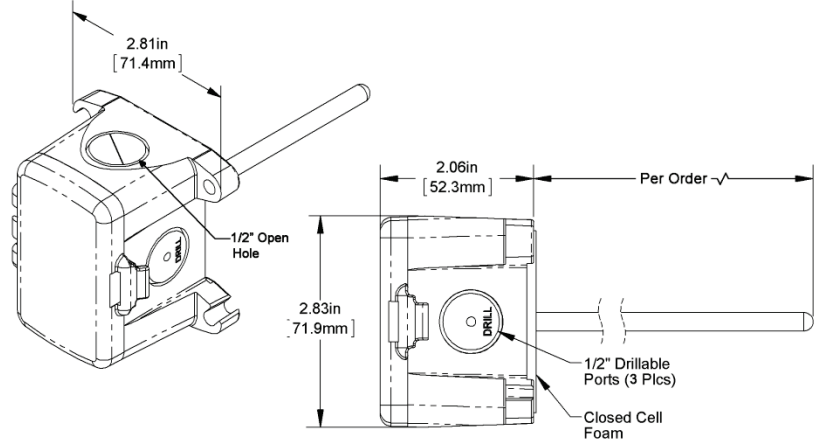


Figure 2: Duct Unit with BB4 Enclosure

Part #s:

- NSB-10K-2-D-4-BB4 (4" probe)
 - NSB-10K-2-D-8-BB4 (8" probe)
 - NSB-10K-2-D-12-BB4 (12" probe)
 - NSB-10K-2-D-18-BB4 (18" probe)
- A Pierceable Knockout Plug (Part #NSB-PKP-100) is available for the open port in the BB4.

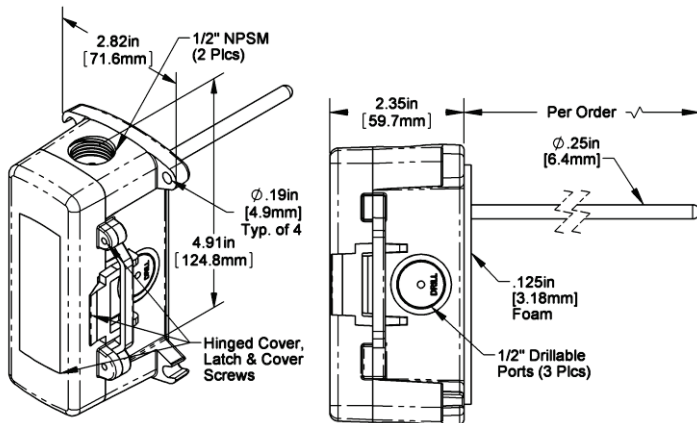


Figure 3: Duct Unit with BB2 Enclosure

Part #s:

- NSB-10K-2-D-4-BB2 (4" probe)
- NSB-10K-2-D-8-BB2 (8" probe)
- NSB-10K-2-D-12-BB2 (12" probe)
- NSB-10K-2-D-18-BB2 (18" probe)

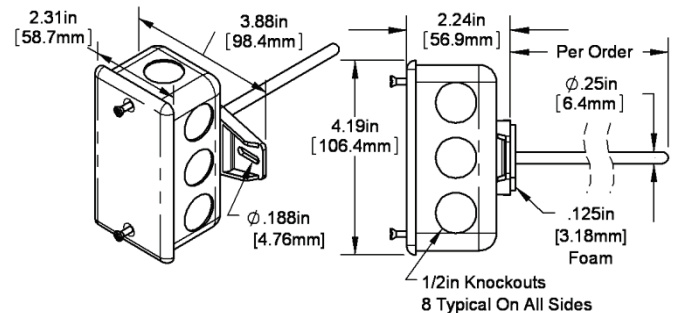


Figure 4: Duct Unit with standard J-Box

Part #s:

- NSB-10K-2-D-4 (4" probe)
- NSB-10K-2-D-8 (8" probe)
- NSB-10K-2-D-12 (12" probe)
- NSB-10K-2-D-18 (18" probe)

Specifications subject to change without notice.

Specifications

Sensor	Passive, NTC, 2 wire	Enclosure Types	
Thermistor	Thermal resistor	No Box (NB)	Intended for open wiring
Temp. Output	Resistance	J-Box (JB)	With eight ½” knock-outs
Accuracy (Std) (±0.2°C)	±0.36°F,	BB2 box	With three ½” NPSM and three ½” drill-outs
Stability	< 0.036°F/Year,	BB4 box	With three ½” drill-outs, one ½” open port
(<0.02°C/Year) Heat dissipation	2.7 mW/°C	Enclosure Ratings	
Temp. Drift	<0.02°C per year	No Box (NB)	No rating
Probe range	-40° to 221°F (-40° to 105°C)	J-Box (JB)	NEMA 1
Sensitivity	Approximate @ 32°F (0°C)	BB2 box	NEMA 4, IP66, UV
Thermistor	Non-linear	Rated	
Lead wire	22AWG stranded	BB4 box	IP10 (IP44 with Knockout Plug in open port)
Wire Insulation	Etched Teflon, Plenum rated	Enclosure Material	
Probe	304 Stainless steel, 0.25” OD	No Box (NB)	Nylon 66, UL94H-B
Probe Length	4”, 8”, 12”, or 18” or per order	J-Box (JB)	Galvanized steel, UL94H-B
Mounting	Extension tabs (ears), 3/16” holes	BB2 box	Polycarbonate, UL94V-0, UV rated
Duct Gasket	1/4” Closed cell foam (impervious to mold)	BB4 box	Polycarbonate and Nylon, UL94V-0
		Ambient (Enclosure)	0 to 100% RH, Non- condensing
		No Box (NB)	-40 to 212°F (-40 to 100°C)
		J-Box (JB)	-40 to 212°F (-40 to 100°C)
		BB2, BB4	-40 to 185°F (-40 to 85°C)
		Agency	RoHS PT= DIN43760, IEC Pub 751-1983, JIS C1604-1989

#20787 – 1/10/19

Mounting

1. Place the sensor in the middle of the duct away from temperature stratified air, coils or humidifiers to achieve the best temperature reading.
2. Drill the probe hole as depicted on this page for the enclosure being used. Insert the probe into the duct.
3. Mount the enclosure to the duct using #8 screws through a minimum of two opposing mounting tabs. A 1/8 inch pilot screw hole in the duct makes mounting easier through the mounting tabs. Use the enclosure tabs to mark the pilot hole locations.
4. Snug up the sensors so that the foam backing is depressed to prevent air leakage but do not over-tighten or strip the screw threads.

NOTES

- Do not drill into the water tight enclosures which will violate the NEMA and/or IP rating.
- Use caulk or Teflon tape for your conduit entries to maintain the appropriate NEMA or IP rating for your application.
- Conduit entry for outdoor or wet applications should be from the bottom of the enclosure.

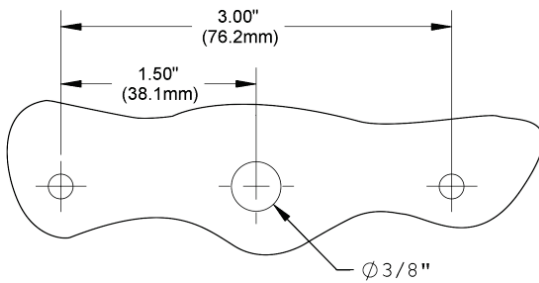


Figure 5: Junction Box or No Box Mounting Holes

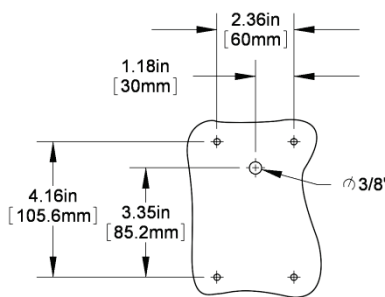


Figure 6: BB2 Enclosure Mounting Holes




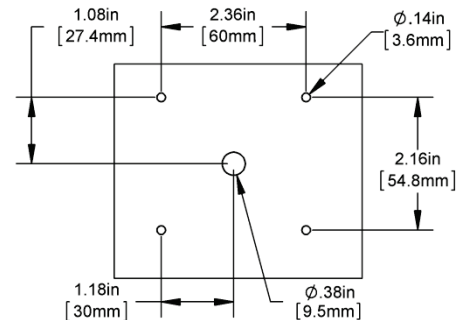


Figure 7: BB4 Enclosure Mounting Holes

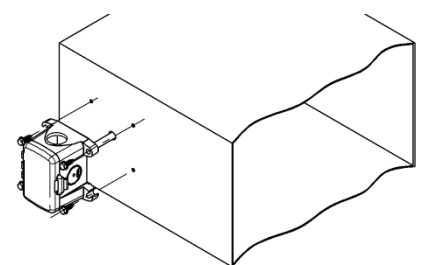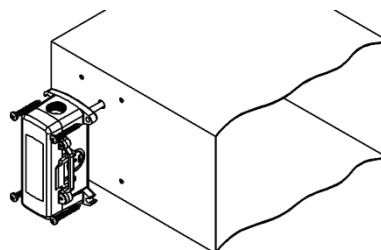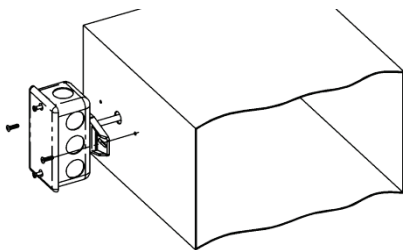

Specifications subject to change without notice.

#20787 – 1/10/19

Wiring and Termination

Carrier recommends using twisted pair of at least 22 AWG and sealant filled connectors for all wire connections. Larger gauge wire may be required for long runs. All wiring must comply with the National Electric Code (NEC) and local codes. Do NOT run this device's wiring in the same conduit as high or low voltage AC power wiring. Tests show that inaccurate signal levels are possible when AC power wiring is present in the same conduit as the sensor wires.

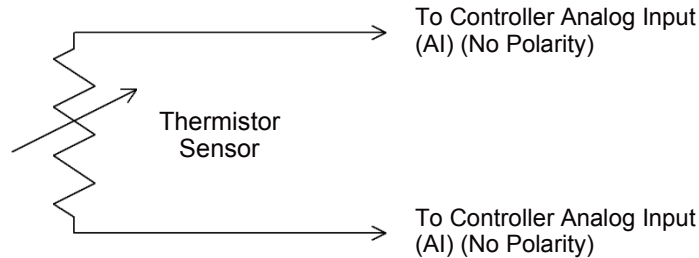


Figure 8: 2 Wire Lead Wire Termination for Thermistor

Diagnostics

Problems:

Controller reports higher or lower than actual temperature

Possible Solutions:

- Confirm the input is set up correctly in the front end software
- Check wiring for proper termination and continuity. (shorted or open)
- Disconnect wires and measure sensor resistance and verify the "Sensor" output is correct.

Specifications subject to change without notice.



Su socio estratégico en
soluciones de control



Conózcenos en nuestra web

Somos expertos en el desarrollo, instalación y mantenimiento de Sistemas de Control. Proveemos soluciones integrales de automatización y control para todo tipo de Edificios Inteligentes.

[Ir a anzures.com.ar](http://anzures.com.ar)



Descubra nuevas soluciones

Conozca nuestra serie de documentos con soluciones integrales que mejoran el control y la eficiencia, y nuestros últimos casos de éxito.


[Ir a anzures.com.ar/soluciones](http://anzures.com.ar/soluciones)



Explore otros equipos

Encuentre los productos necesarios para la gestión de edificios inteligentes o industrias; controladores BACnet HVAC, sistemas Carrier Confort Network, sensores y add-ons.

[Ir a anzures.com.ar/productos](http://anzures.com.ar/productos)

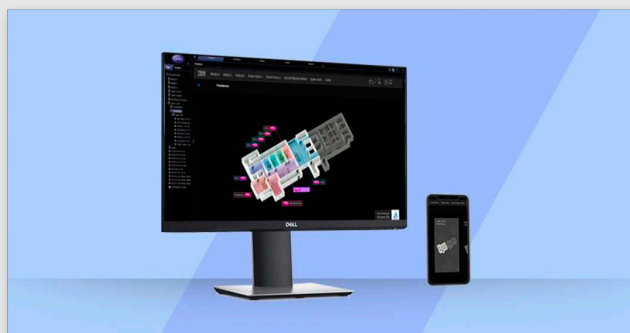

Pruebe nuestra demo i-Vu

Experimente nuestra interfaz gráfica para el control de equipos que se encuentran en los sistemas de edificios e industrias. Interactúe como si fuera un operador mediante el sistema i-Vu.

[Ir a anzures.com.ar/sistema](http://anzures.com.ar/sistema)



Email

ivupro@anzures.com.ar



Web

anzures.com.ar



Redes sociales



Teléfono

+54 11 6012 5590